


PIPE DIA. INCHES	X = SETTING INCHES
2	6
3	7
4	8
6	12
8	13
10	17
12	21
16	30



# STANDARD GATE VALVE BOX SETTING  
C### NTS

State of Wisconsin  
Department of Administration  
Division of Facilities Development

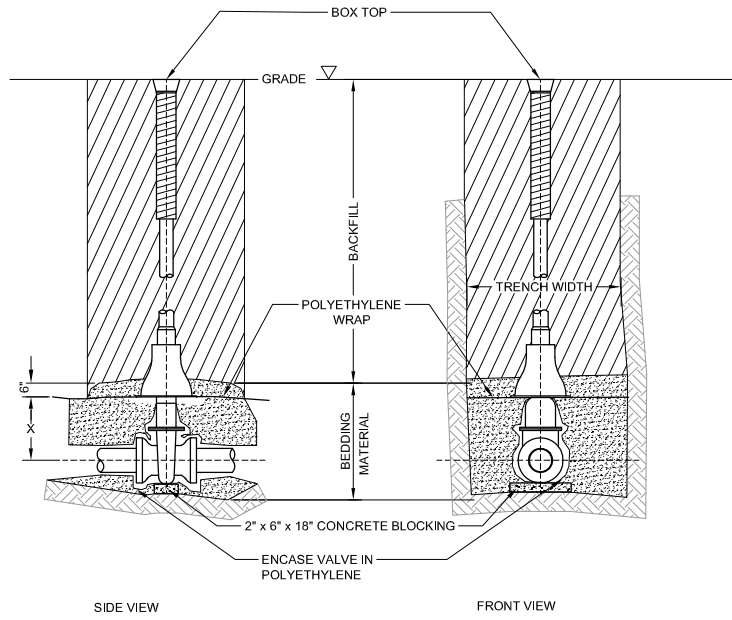

DFD Civil Details Library

Sheet Title:  
STANDARD GATE VALVE BOX SETTING

Revisions:		
No.	Date:	Description:

Graphic Scale	
DFD Number	
Set Type	
Date Issued	8/1/2017
Sheet Number	